


UNDERGROUND WATER METER LOCATION FOR 1", 1 1/2", OR 2"
 TYP FOR SINGLE FAMILY DETACHED OR IRRIGATION

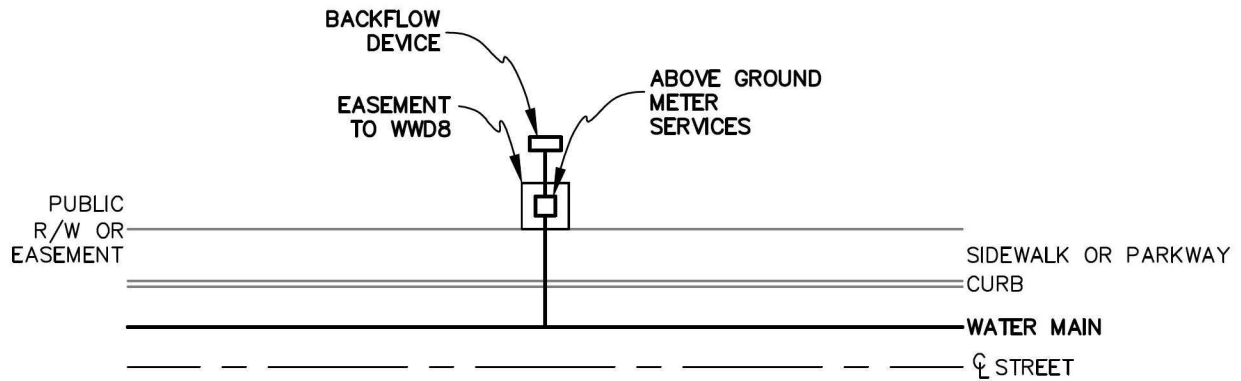

ABOVE GROUND MASTER WATER METER LOCATION FOR 3" AND LARGER
 TYP FOR MULTI-FAMILY RESIDENTIAL OR COMMERCIAL

NOTES:

1. UNDERGROUND WATER METERS SHALL BE LOCATED 1 FT (MIN) FROM THE PROPERTY LINE, DIRECTLY BEHIND THE CURB.
2. PERMANENTLY MARK THE TOP OF CURB WITH A "W" AT METER LOCATIONS.
3. METER BOXES SHALL NOT BE INSTALLED ON DRIVEWAY APPROACHES OR WITHIN 2 FT FROM THE EDGE OF DRIVEWAYS.
4. MAINTAIN 10 FT (MIN) SEPARATION BETWEEN WATER SERVICES AND SEWER LATERALS.
5. ALL MATERIALS AND CONSTRUCTION SHALL MEET THE REQUIREMENTS AS SPECIFIED IN THE CITY'S "WATER DESIGN AND CONSTRUCTION STANDARDS" MANUAL.
6. PRE-APPROVED MANUFACTURES AND MODEL NUMBERS ARE LISTED IN THE CITY'S "APPROVED MATERIALS LIST FOR WATER IMPROVEMENT PROJECTS."



**Ventura County
 Waterworks
 District No. 8**

LOCATION OF WATER METERS

RECOMMENDED: */s/*
 DEPUTY DIRECTOR / DISTRICT ENGINEER

APPROVED: */s/*
 DIRECTOR OF PUBLIC WORKS

JUL 2021

PLATE
 209