



# CREEK BOTTOM

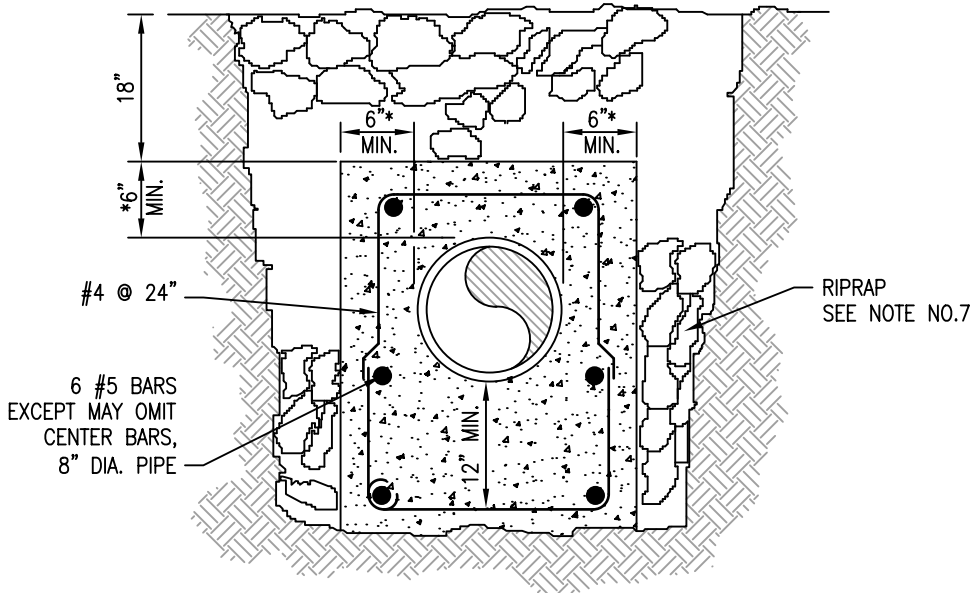

**TYPE A**  
NOT TO SCALE

## NOTES:

1. REFER TO PROJECT SOILS REPORT FOR ADDITIONAL REQUIREMENTS.
2. WRAP PIPE WITH 15# ROOFING PAPER. PIPE WRAPPING IS NOT REQUIRED FOR PLASTIC PIPE.
3. ALL JOINTS TO BE TIED DOWN TO PREVENT FLOATING.
4. FOR ALL REBARS KEEP MIN. 3 INCHES OF CLEARANCE.
5. CONCRETE SHALL BE VIBRATED.
- \*6. PLACE 6 INCHES MINIMUM CONCRETE ABOVE THE PIPE AND @ BOTH SIDES FROM PIPE.
7. 6 INCHES MINIMUM RIPRAP CHOCKED WITH SAND AS REQUIRED.
8. PLACEMENT OF CONCRETE SHALL BE ON A FIRM FOUNDATION.
9. BACKFILL SHALL COMMENCE WHEN THE CONCRETE STRENGTH IS 75% OF THE SPECIFIED STRENGTH

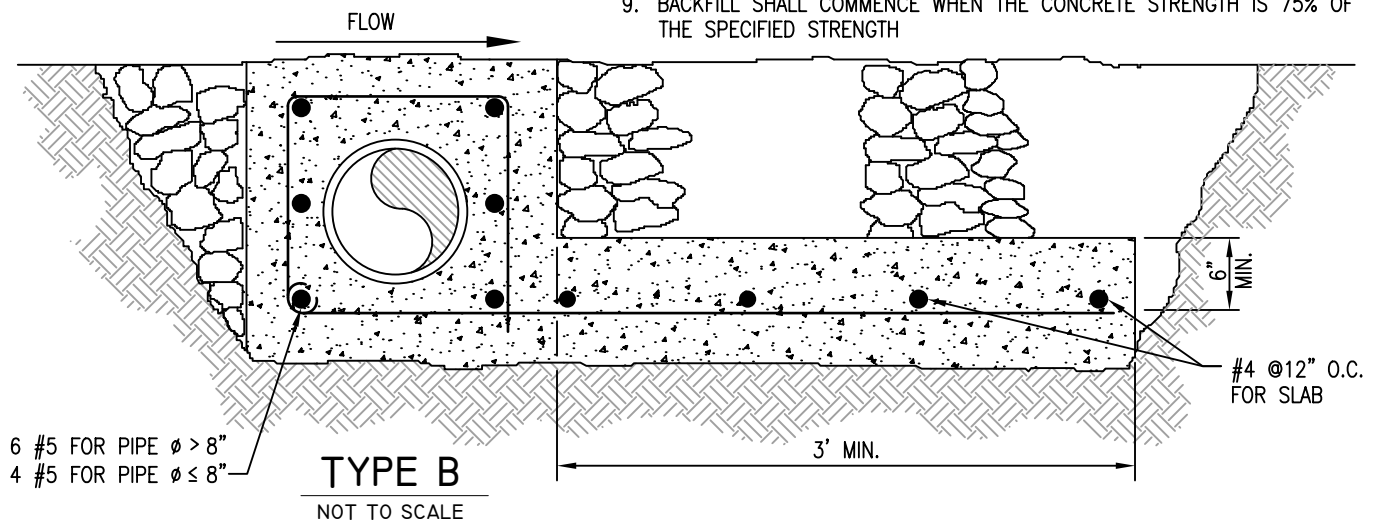

**TYPE B**  
NOT TO SCALE

APPROVED:  
/S/  
DIRECTOR OF PUBLIC WORKS  
Aug 28, 2006  
DATE

CITY OF  
SIMI VALLEY  
DEPARTMENT OF PUBLIC WORKS

SPECIAL PIPE ENCASEMENT  
FOR DRAINAGE COURSES

STANDARD PLAN NO.  
SV 40-80  
SHEET 1 OF 1